


-15kV TOF: -9181 v
 -3.6kV MCP: -3364 v
 -2.4kV MCP: -1784 v
 Input Cur: 296 ma
 RPA max: 237 v
 Mirror max: 238 v

Thu Dec 21 06:24:52 2006

TIDE Direct Events

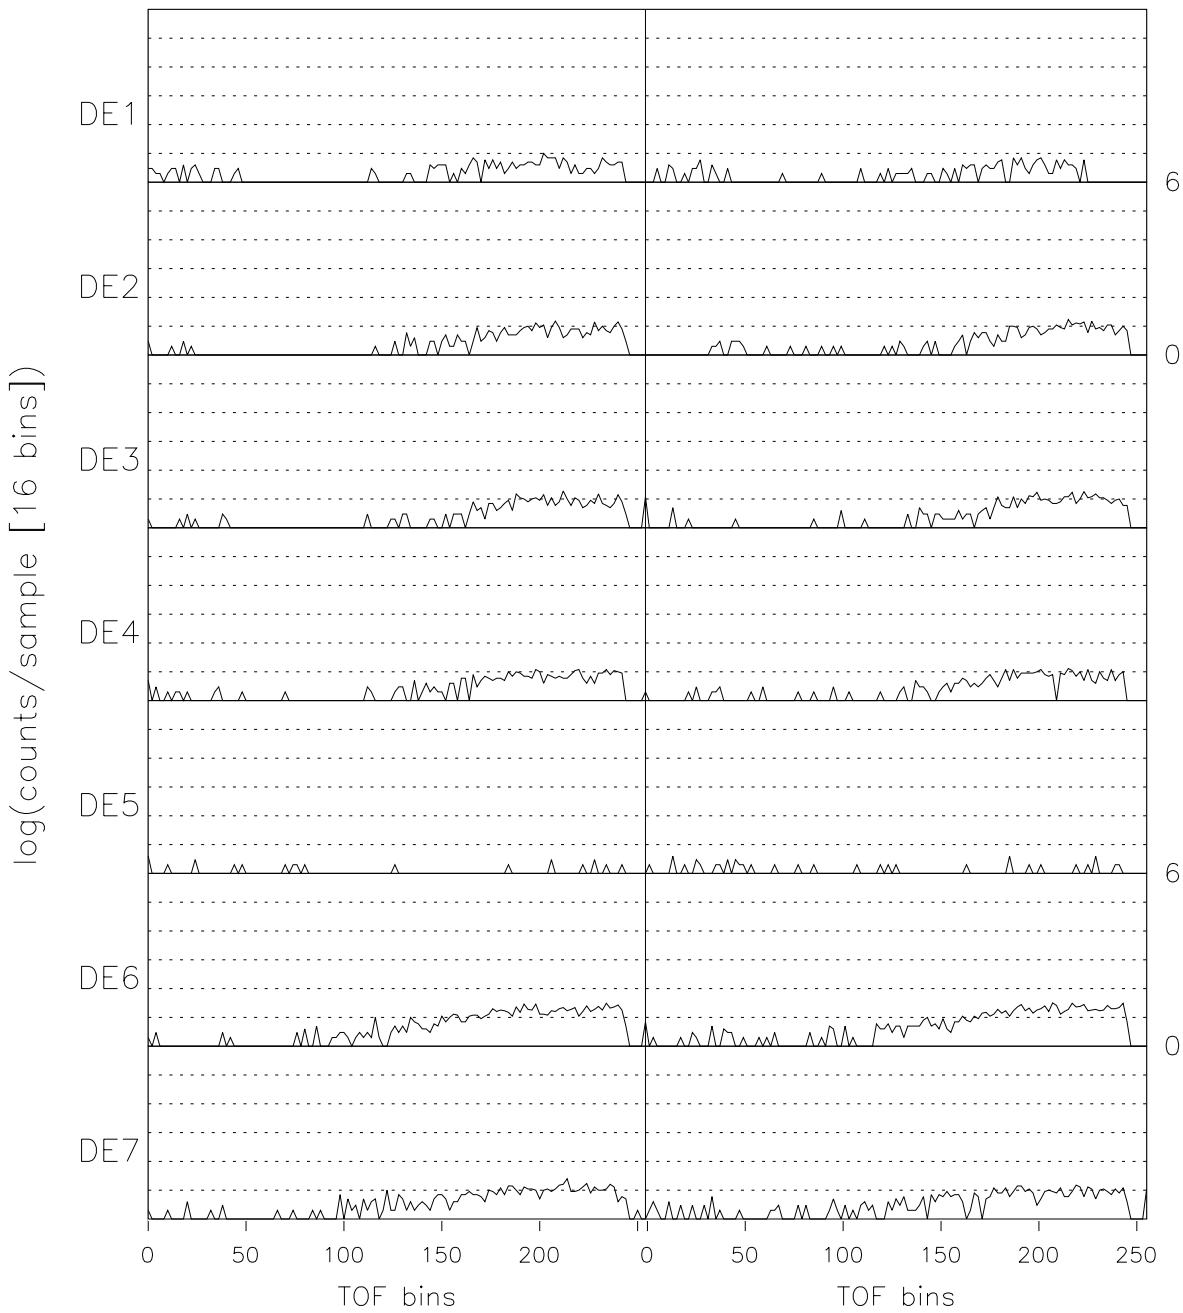

reported: 12-20-06 23:40:04 UT

reported: 12-20-06 23:43:16 UT

file: /export/data/tide/nrt/nrt0612202328.lz

-15kV TOF: -9245 v

-3.6kV MCP: -3364 v

-2.4kV MCP: -1784 v

Input Cur: 314 ma

RPA max: 240 v

Mirror max: 238 v